










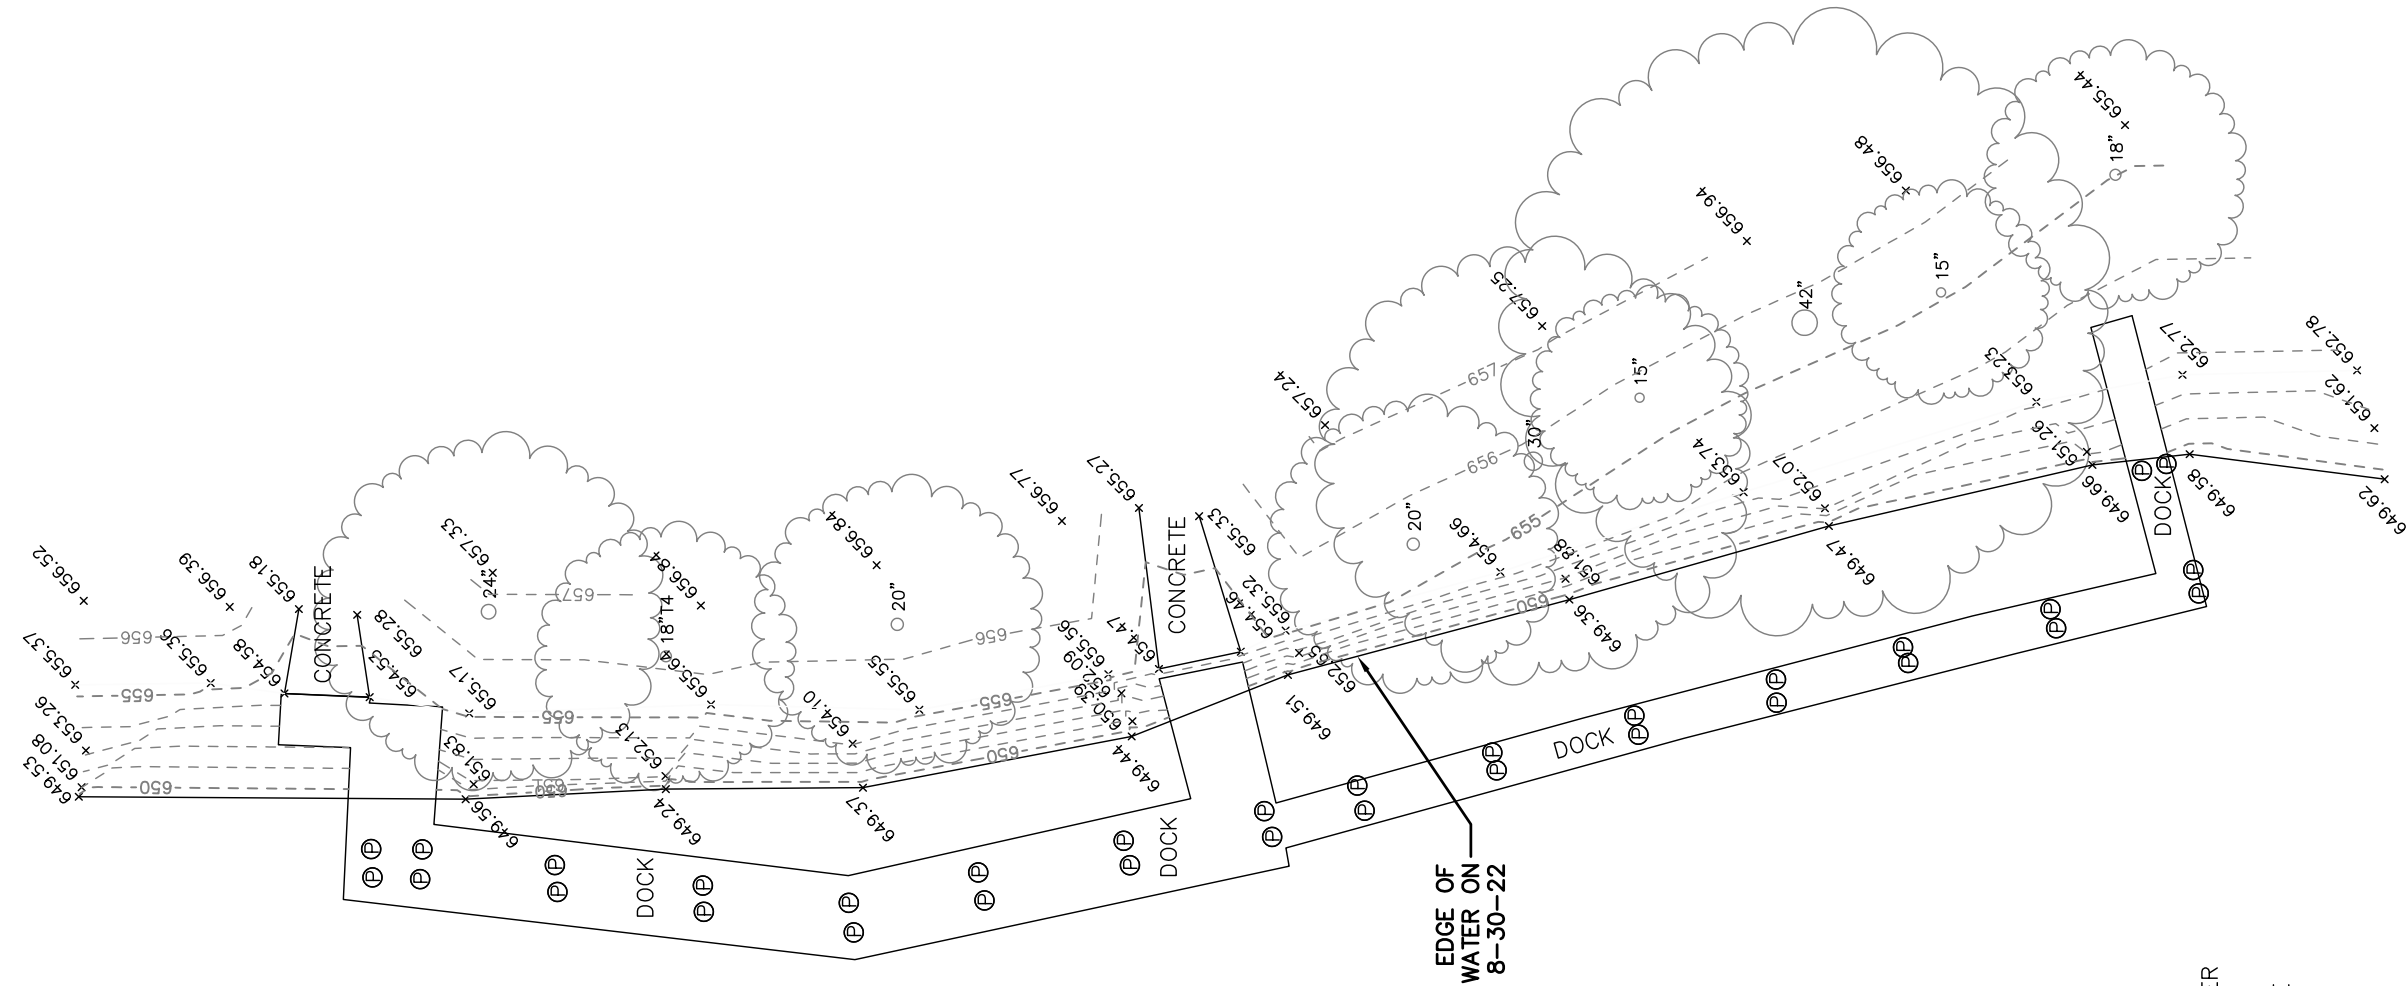








FRENCH LANDING
DOCK RENOVATION
12090 HAGGERTY RD. BELLEVILLE, MI 48111

FRENCH LANDING
DOCK RENOVATION
12090 HAGGERTY RD., BELLEVILLE, MI 48111

DIRECTORY		DRAWING INDEX	
ARCHITECT HOPPE DESIGN 47032 McBRIDE BELLEVILLE, MI 48111 734-218-2492	APPLICANT AND OWNER VAN BUREN TOWNSHIP	CIVIL	
		DT	TITLE SHEET
		SURVEY	TOPOGRAPHIC SURVEY (FOR REFERENCE ONLY)
SURVEYOR ALPINE ENGINEERING 46982 WEST ROAD, SUITE 109 NOVI, MI 48377		STRUCTURAL	
		S001	STRUCTURAL NOTES
		ARCHITECTURAL	
		A101	PARTIAL SITE PLAN, ELEVATIONS AND DETAILS
		A102	PARTIAL SITE PLAN AND DETAILS
		A103	PARTIAL SITE PLAN AND DETAILS
		ELECTRICAL	
		E101	LIGHTING PLAN



LEGEND

- | | | | |
|---|------------------|---|--------------------|
|  | EX. CATCH BASIN |  | EX. TREE LINE |
|  | EX. MANHOLE |  | EX. FENCE |
|  | EX. END SECTION |  | EX. SANITARY SEWER |
|  | EX. HYDRANT |  | EX. STORM SEWER |
|  | EX. LIGHTPOLE |  | EX. WATER MAIN |
|  | EX. UTILITY POLE |  | EX. OVERHEAD LINE |
|  | EX. GUY ANCHOR | | |
|  | EX. POST/BOLLARD | | |
|  | FOUND IRON | | |
|  | SET IRON | | |
|  | EX. TREE | | |

[illegible]

DATE:	9/1/2022
DRAWN BY:	TTP
CHECKED BY:	GLM
FBK:	1
CHF: BAJ	
SCALE	HOR 1"= 20 FT. VER 1"= FT.
	21-323

CLIENT:

DAVENPORT BROTHERS CONSTRUCTION

PARTIAL TOPOGRAPHIC SURVEY

12090 HAGGERTY ROAD
TOWNSHIP: 3S
VAN BUREN TOWNSHIP
WAYNE COUNTY
MICHIGAN
SECTION: 24
RANGE: 8E

DESCRIPTION	MANUFACTURER	MODEL	STYLE	FINISH	COLOR	STANDARD/ RESPONSIBILITY	COMMENTS	REMARKS
DIVISION 3								
DIVISION 4								
DIVISION 5								
STRUCTURAL STEEL		Fy= 50 KSI			N/A	ASTM A36; A992	HOLES TO BE DRILLED NOT BURNED.	X
W SHAPES		Fy= 50 KSI			N/A	ASTM A992		X
CHANNELS, ANGLES, PLATES		Fy= 50 KSI			N/A	ASTM A36		X
150 RECTANGULAR SQUARE		Fy= 46 KSI TYPE 3				ASTM A305		X
BOLTS: STRUCTURAL NUTS, BOLT WASHERS					N/A	ASTM A325-N 110H11 STRENGTH: F 1554	3/4" UNO. PROVIDE WASHERS BENEATH TURNED ELEMENTS	X
					N/A	ASTM A563	HARDENED, HOT DIPPED GALVANIZED	X
					N/A	ASTM F 436; A 36	ALL EXTERIOR LINTELS TO BE GALVANIZED AND PAINTED. INTERIOR LINTELS TO BE PAINTED.	X
STEEL LINTELS			G 60		BY OWNER			
STEEL BARS, SHAPES, CLIPS		Fy= 33 KSI	G 60		N/A	A 305-38M		
STEEL SHEET PILING			G 60		N/A	A 663-663M		
WELDING ELECTRODES		TYPE 1 HIGH STRENGTH	G 70		N/A	AWS D1.1 SPECIFICATIONS.		
		308C PANT 30 5 OC P- 21035			RED	ASTM 233		
DIVISION 6								
TREATED LUMBER: BELOW GRADE					N/A	AWPA UCA 1A	90% RETENTION; AMONIA FREE	
TREATED LUMBER: ABOVE GRADE					N/A	AWPA UC3B	90% RETENTION; AMONIA FREE	
TREATED LUMBER HARDWARE	SIMPSON	G 185			N/A		HOT DIPPED GALVANIZED OR STAINLESS STEEL	X
TREATED LUMBER IN CONTACT WITH CONC.						AWPA C2	90% RETENTION; AMONIA FREE	
BOLTS FOR WOOD CONSTRUCTION		S&W GRADE 2 OR 5						
JOISTS AND LVL'S		FU= 2600 PSI Fy= 240 PSI UNO			N/A		ACAFOR DOUGLAS FIR OR CCATOR SOUTHERN PINE.	X
WOOD PRESERVATIVE								
COMPOSITE DECKING BOARDS	TREX					COLOR SELECTION BY OWNER.		X

GENERAL
IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ADEQUATE SHORING AND BRACING DURING CONSTRUCTION TO ACCOUNT FOR ALL FORCES, INCLUDING BUT NOT LIMITED TO FORCES FROM GRAVITY, EARTH, WIND AND UNBALANCED FORCES DUE TO CONSTRUCTION SEQUENCES.

THE STRUCTURAL INTEGRITY OF THE BUILDING SHOWN ON THESE PLANS IS DEPENDENT UPON COMPLETION ACCORDING TO PLANS AND SPECIFICATIONS. STRUCTURAL MEMBERS ARE NOT SELF BRACING AND SHALL BE SHORED AND/OR BRACED BY THE CONTRACTOR AS NECESSARY UNTIL STABILIZED BY VIRTUE OF COMPLETED CONNECTIONS.

FIELD MEASURE AND VERIFY ALL DIMENSIONS AND ELEVATIONS BEFORE FABRICATION.

FOUNDATIONS
ALL FOOTINGS SHALL BEAR ON UNDISTURBED SOIL, HAVING A MINIMUM SAFE BEARING CAPACITY. THE TESTING AND INSPECTION AGENCY SHALL VERIFY SOIL BEARING CAPACITY AT EACH FOOTING PRIOR TO INSTALLATION OF FOOTING. NOTIFY ENGINEER OF ANY VARIATION FROM ANTICIPATED BEARING CAPACITY FOR APPROPRIATE RE-DESIGN OR LOWERING OF FOOTING.

THE BOTTOMS OF ALL EXTERIOR FOOTINGS SHALL BE 3'-6" MINIMUM BELOW FINISHED GRADE. IF THE BUILDING WILL BE UNDER CONSTRUCTION DURING FREEZING WEATHER, ALL INTERIOR FOUNDATIONS SHALL BE DEPRESSED 3'-6" BELOW CONSTRUCTION GRADE FOR FROST PROTECTION. IF SUCH ADDITIONAL FOOTING DEPTH WILL CAUSE UNDERMINING OF ADJACENT EXISTING FOOTINGS OR STRUCTURES, PROVIDE APPROPRIATE SHORING, BRACING OR UNDERPINNING AS REQUIRED OR LEAVE FOOTING ELEVATION AS DESIGNED AND PROVIDE CONTINUED PROTECTION AND HEAT TO PREVENT FORMATION OF FROST BELOW FOOTING AND ADJACENT TO FOOTING.

THE CONTRACTOR SHALL SAFEGUARD AND PROTECT ALL EXCAVATIONS AND ADJACENT STRUCTURES, PAVEMENTS, AND UTILITIES. ALL EXCAVATIONS SHALL BE KEPT FREE OF WATER. THE CONTRACTOR IS RESPONSIBLE FOR THE DESIGN, INSTALLATION, MAINTENANCE AND REMOVAL OF ALL SHORING, BRACING, AND DEWATERING THAT IS REQUIRED TO PROPERLY CONSTRUCT THE FOUNDATIONS AND PROTECT ADJACENT STRUCTURES, PAVEMENTS AND UTILITIES.

PRETREAT EXCAVATIONS WITH TERMITICIDE AND INSPECT EXCAVATIONS PRIOR TO POURING CONCRETE.

TEMPORARY BRACING MUST BE PROVIDED TO RESIST ALL LATERAL FORCES UNTIL STRUCTURAL SYSTEM IS SELF SUPPORTING.

CONCRETE SLABS
PLUMBING AND ELECTRICAL CONTRACTORS ARE TO PROVIDE ALL REQUIRED UNDERSLAB WORK PRIOR TO POURING THE FLOOR SLAB.

INSPECT ALL REINFORCING BEFORE POURING CONCRETE.

SLOPE SLABS TO FLOOR DRAINS. VERIFY DEPRESSIONS AND FLOOR FINISHES.

PROVIDE 3" CONCRETE COVER MINIMUM FROM TOP OF SLAB TO SLAB REINFORCING AND LAP ALL STEEL FABRIC SPLICES 6" MIN. REINFORCING SHALL BE CENTERED IN SLAB.

GRANULAR BASE TO BE COMPACTED TO 95% MODIFIED PROCTOR DENSITY UNDER ALL SLABS ON GRADE.

REINFORCING
MINIMUM CONCRETE COVERING SHALL BE:
3" FOOTING BOTTOM
2" COLUMNS, BEAMS AND FORMED SURFACES IN DIRECT CONTACT WITH SOIL OR EXPOSED TO THE WEATHER, EXCEPT SLABS.
2" DECK SLAB TO TOP
1" DECK SLAB TO BOTTOM
1" INTERIOR FACES OF WALLS AND SLABS NOT EXPOSED TO WEATHER
3" INTERIOR SLABS

MASONRY
MASONRY WALLS ARE TO BE ADEQUATELY BRACED DURING CONSTRUCTION. SEE "STANDARD PRACTICE FOR BRACING MASONRY WALLS UNDER CONSTRUCTION" BY THE COUNCIL FOR MASONRY WALL BRACING AND ALSO NOMA TEK 304B "BRACING CONCRETE MASONRY WALLS DURING CONSTRUCTION" FOR RECOMMENDATIONS REGARDING BRACING.

PLACE LADDER TYPE HORIZONTAL JOINT REINFORCING WITH PREFORMED LAPPED CORNER REINFORCING.

THE DISCONTINUOUS ENDS OF ALL MASONRY WALLS SHALL BE SOUDLY GROUTED A MINIMUM OF 8" OR ONE BLOCK CELL AND REINFORCED FOR THEIR FULL HEIGHT WITH ONE #5 BAR UNO.

AT GROUTED CELLS LIFTS OF GROUT SHALL BE KEYED 4" INTO THE COURSE OF MASONRY BELOW.

ALL CMU BOND BEAMS TO HAVE (2) #4 BARS CONTINUOUS. PROVIDE (2) #4 L BARS AT EVERY CORNER LAPPED 3'-0" WITH CONTINUOUS BARS.

VERTICAL CONTROL JOINTS IN CMU WALLS TO HAVE A MINIMUM 3/8" GAP AND SHALL BE LOCATED BY THE ARCHITECT, BUT NOT MOVE THAN 20'-0" OC.

BRICK TIES SHALL BE GALVANIZED ADJUSTABLE 2-PIECE WIRE TIES OF NOT LESS THAN 9 GAGE AND SHALL BE SPACED AT 16" OC VERTICALLY AND HORIZONTALLY.

WHERE MASONRY MEETS STRUCTURAL MEMBERS SUBJECT TO VERTICAL DEFLECTION, PROVIDE ALLOWANCE FOR VERITICAL MOVEMENT OF L/240 OF STRUCTURAL MEMBER.

BOND BEAM REINFORCING TO BE CONTINUOUS ACROSS CONTROL JOINTS.

PROVIDE A 24" LAP AT FOUNDATION DOWELS.

AIR TEMPERATURE AT TIME OF MASONRY INSTALLATION SHALL BE 40<T<90 DEGREES F.

METAL DECK
UNLESS OTHERWISE NOTED, ALL METAL DECK HAS BEEN DESIGNED TO BE CONTINUOUS OVER 3 SPANS MINIMUM AND SHALL BEAR AT LEAST 2" ON STEEL SUPPORTS. FOR ONE OR TWO SPAN CONDITIONS, THE CONTRACTOR SHALL PROVIDE SHORING AS REQUIRED OR FURNISH HIGHER GAGE DECK AS REQUIRED TO SUPPORT ALL THE APPLICABLE LOADS. CONTRACTOR SHALL SUBMIT ALTERNATE FOR APPROVAL.

PROVIDE REINFORCING CHANNELS, STANDARD CLOSURES, CANT STRIPS, SUMP PANS, FINISH STRIPS, POUR STOPS, AND OTHER ACCESSORIES AS REQUIRED FOR PROPERLY FINISHED JOB, EVEN IF NOT SPECIFICALLY SHOWN ON THE DRAWINGS. PROVIDE BEARING ANGLES WELDED TO COLUMNS TO SUPPORT METAL DECKS AS REQUIRED.

FASTEN STEEL DECK UNITS TO STRUCTURAL SUPPORTS USING HEX WASHER HEAD TEK SCREWS OR ARC SPOT WELDS ACCORDING TO MANUFACTURER'S SPECIFICATIONS AND IN CONFORMANCE WITH THE STEEL DECK INSTITUTES SPECIFICATION SECTION 4.4.

ARC SPOT WELDS (PUDDLE WELDS) TO SUPPORTS SHALL HAVE A DIAMETER OF 3/8" MINIMUM OR AN ELONGATED WELD OF 3/4" MINIMUM WDTH AND 3/4" MINIMUM LENGTH. WELD METAL SHALL PENETRATE ALL LAYERS OF DECK MATERIAL AT END LAPS AND HAVE ADEQUATE FUSION TO THE SUPPORTING MEMBERS. WELDING SHALL BE DONE IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY STANDARD "S" SPECIFICATION FOR WELDING SHEET STEEL IN STRUCTURES" AWS D1.3.

UNITS SHALL BE FASTENED TO THE STEEL SUPPORTS AT THE END OF THE UNITS AND AT INTERMEDIATE SUPPORTS AND TO THE STEEL SUPPORTS AT THE SIDE BOUNDARIES BY 3/4" DIAMETER PUDDLE WELDS AT 12" OC. SHEAR STUDS WELDED THROUGH DECK MAY BE USED IN PLACE OF 3/4" DIAMETER PUDDLE WELDS.

THE SIDE LAPS OF ADJACENT UNITS SHALL BE FASTENED BETWEEN SUPPORTS BY BUTTON PUNCHING AT 24" OC UNO.

STRUCTURAL STEEL
UNLESS OTHERWISE NOTED, ALL BEAMS AND LINTELS BEARING ON MASONRY SHALL HAVE A MINIMUM BEARING LENGTH OF 7 1/2" AND SHALL HAVE A MINIMUM OF TWO BLOCK COURSES AT 32" LONG OF SOLID MASONRY UNDER THE BEARING SURFACE.

WHERE STEEL CONNECTIONS ARE NOT FULLY DETAILED ON THE DESIGN DRAWINGS (WITH ALL REQUIREMENTS FOR BOLTS, PLATES, WELDS, DIMENSIONS, ETC SHOWN) CONNECTIONS SHALL BE DESIGNED BY THE STEEL CONTRACTOR UNDER THE SUPERVISION OF A P.E. LICENSED IN THE STATE THAT HAS JURISDICTION OVER THE PROJECT.

WHERE TYPICAL OR INCOMPLETE CONNECTIONS ARE SHOWN ON THE DESIGN DRAWNGNS, THOSE DETAILS SHALL BE USED AS A BASIS FOR CONNECTION DESIGN TO BE COMPLETED BY THE CONTRACTOR. ALTERNATE CONNECTIONS DESIGNED BY THE STEEL CONTRACTOR WILL BE PROVIDED IF REQUIRED DESIGN FORCES CANNOT BE ACHIEVED BY THE TYPICAL OR EXAMPLE CONNECTION, OR IF AUTHORIZATION TO ALTER THE DETAIL IS PROVIDED BY THE DESIGN ENGINEER.

WHERE CONNECTION FORCES ARE INDICATED ON THE DRAWINGS, PROVIDE CONNECTIONS DESIGNED TO RESIST THE FORCE SHOWN.

WHERE CONNECTION FORCES ARE NOT INDICATED ON THE DRAWINGS, PROVIDE CONNECTIONS DESIGNED TO RESIST FORCES AS FOLLOWS: FOR SHEAR CONNECTIONS IN NON-COMPOSITE MEMBERS, DESIGN CONNECTIONS TO RESIST 50% OF THE TOTAL ALLOWABLE UNIFORM LOAD SHOWN IN THE TABLES IN PART 3 OF THE AISC MANUAL OF STEEL CONSTRUCTION. FOR SHEAR CONNECTIONS IN COMPOSITE MEMBERS, DESIGN CONNECTIONS TO RESIST 75% OF THE TOTAL ALLOWABLE UNIFORM LOAD SHOWN IN THE TABLES IN PART 3 OF THE AISC MANUAL OF STEEL CONSTRUCTION. FOR MOMENT CONNECTIONS, DESIGN CONNECTIONS TO RESIST 100% OF MOMENT CAPACITY OF THE MEMBER.

ALL FULLY TENSIONED A490 BOLTS SHALL HAVE WASHERS BENEATH BOTH NUT AND HEAD. PROVIDE TEMPLATES TO LOCATE ANCHOR BOLTS AND BASE PLATES.

SHOP AND FIELD CONNECTIONS SHALL BE MADE BY WELDING OR HIGH STRENGTH BOLTING. BOLTED CONNECTIONS SHALL CONFORM TO ASTM A325-X USING LOAD INDICATOR WASHERS (LIW) OR LOAD INDICATOR BOLTS (LIB). BEAM CONNECTIONS SHALL PROVIDE SHEAR CAPACITY TO SUPPORT A REACTION R EQUAL TO HALF THE SHEAR CAPACITY OF BEAM. USE 1" DIA BOLTS, E70XX 1/2" WELD AND 5/8" ANGLE THICKNESS.

ALL WELDING SHALL BE PERFORMED USING THE ELECTRIC ARC METHOD IN ACCORDANCE WITH THE LATEST REVISION OF THE AWS D1.1. E70XX ELECTRODES CONFORMING TO AWS A5.1 OR A5.5 SHALL BE USED FOR SHIELDED METAL ARC METHOD AND FX7-ECXX ELECTRODE CONFORMING TO AWS F5.17 FOR SUBMERGED ARC METHOD.

ALL WELDS SHALL BE PROVIDED AS SHOWN IN THE STRUCTURAL DETAILS UNLESS THICKER WELD IS REQUIRED DUE TO MATERIAL THICKNESSES. WHERE WELD IN NOT DETAILED, WELD SHALL BE DESIGNED BY A LICENSED ENGINEER RETAINED BY THE CONTRACTOR TO MEET CONNECTION CAPACITY REQUIREMENTS LISTED ABOVE. WELD SIZES SHALL BE INCREASED AS NEEDED TO MEET THE FOLLOWING MINIMUM WELD SIZE REQUIREMENTS BASED ON THE SMALLER MATERIAL THICKNESS OF THE PIECES OF STEEL BEING WELDED TOGETHER:

MATERIAL THICKNESS	MIN FILLET WELD SIZE (PROVIDE LARGER WELD IF REQUIRED FOR STRESS)
1/4" AND UNDER	3/8"
OVER 1/4" TO 1/2"	1/2"
OVER 1/2" TO 3/4"	3/4"
OVER 3/4"	7/8"

IF PENETRATIONS THROUGH WEBS OF STEEL BEAMS WILL BE REQUIRED, CONTRACTOR TO NOTIFY ENGINEER OF RECORD.

SEE ARCHITECTURAL DRAWINGS FOR MISCELLANEOUS AND NON-STRUCTURAL STEEL.

STEEL JOISTS
PROVIDE AND INSTALL BRIDGING IN ACCORDANCE WITH STEEL JOISTS INSTITUTE STANDARDS. ALL ENDS OF BRIDGING LINES TERMINATING AT MASONRY WALLS SHALL BE ANCHORED THERETO IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. WHERE BRIDGING DOES NOT TERMINATE AT A MASONRY WALL, THE FIRST AND SECOND BAYS FROM THE END OF THE BRIDGING IS TO BE DIAGONAL X-BRIDGING. MANUFACTURER TO PROVIDE ADDITIONAL BRIDGING AS REQUIRED TO SATISFY SA UPLIFT REQUIREMENTS.

WHERE STEEL JOISTS SUPPORT MOVEABLE PARTITIONS, JOIST MANUFACTURER SHALL DESIGN JOIST FOR A MAXIMUM LIVE/SNOW LOAD DEFLECTION OF THE SMALLER OF 1/2" AND L/360.

JOIST MANUFACTURER SHALL LIMIT JOIST DEFLECTION DUE TO LIVE/SNOW LOAD TO L/360.

THE ENDS OF STEEL JOIST SHALL BEAR A MINIMUM DISTANCE OF 2 1/2 INCHES OVER STEEL SUPPORTS AND 4 INCHES OVER ALL OTHER SUPPORTS. THE ENDS SHALL BE FASTENED BY BOLTING AND OR WELDING.

ERECTION OF JOISTS AND JOIST BRIDGING SHALL CONFORM TO ALL REQUIREMENTS OF OSHA AND JOIST MANUFACTURER.

WOOD FRAMING
ALL LUMBER IN CONTACT WITH MASONRY OR STEEL TO BE PRESERVATIVE TREATED.

ALL FLUSH FRAMED CONNECTIONS ARE TO MADE USING JOIST HANGERS DESIGNED FOR THE SPECIFIC CONDITION UNLESS OTHER CONNECTIONS ARE PROVIDED.

SHOP DRAWINGS SHALL BE PROVIDED FOR ALL ENGINEERED WOOD MATERIAL INDICATING PRODUCTS, DETAILS, CONNECTIONS AND ACCESSORIES AS REQUIRED BY THE MANUFACTURE TO MEET PROJECT LOADING REQUIREMENTS.

OBSERVE ALL CODE REQUIREMENTS FOR BRIDGING, BORING, AND NOTCHING OF STUDS AND JOISTS. FOR BRIDGING, BORING AND NOTCHING OF ENGINEERED WOOD PRODUCTS OBSERVE ALL MANUFACTURER REQUIREMENTS.

BRIDGING SHALL BE PROVIDED FOR ALL ROOF RAFTERS.

ALL ROOF RAFTERS ARE TO BE 24" ON CENTER UNLESS OTHERWISE NOTED.

ROOF DESIGN NOTES:
A. VERTICAL WEB MEMBERS FOR ALL GABLE END TRUSSES SHALL BE DESIGNED TO RESIST A HORIZONTAL WIND LOAD RESULTING FROM THE DESIGNED WIND SPEED WITHOUT EXCEEDING THE DEFLECTION LIMIT OF L/600 OF THEIR RESPECTIVE VERTICAL SPANS.
B. BRIDGING FOR BOTTOM CHORDS SHALL BE DESIGNED TO DISTRIBUTE THE HORIZONTAL WIND LOAD PROPOSED ON THE COMPLETE BUILDING TO THE SHEAR WALLS AND SHALL BE DESIGNED FOR A TOTAL IMPOSED WIND LOAD ON BUILDING INCLUDING WINDWARD AND LEeward PRESSURE FROM THE DESIGNED WIND SPEEDS.


LOADS AND REFERENCES		
DESIGN LOADS		
TABLE 1604.5	OCCUPANCY CATEGORY	II
	WIND	
FIGURE 1609.3.1	V BASIC WIND SPEED (MPH)	115
SECTION 1609.4.3	EXPOSURE CATEGORY	B
	Iw IMPORTANCE FACTOR	1
	ADJUSTMENT FACTOR	1.12
	SNOW	
FIGURE 1608.2	Pg GROUND SNOW (PSF)	25.00
	Is IMPORTANCE FACTOR	1.00
	Ce EXPOSURE FACTOR	1.00
	Cl THERMAL FACTOR	1.00
	ROOF DEAD LOAD (PSF)	20.00
	CEILING DEAD LOAD (PSF)	5.00
	TOTAL UNFACTORED DESIGN ROOF LOAD (PSF)	25 + 20 + 5 = 50
REFERENCES		
STRUCTURAL LOADS	ASCE-7	2010
CONCRETE	ACI 301	
	ACI 318 BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE	2010
	ACI SP 66	
	PORTLAND CEMENT ASSOCIATION "DESIGN AND CONTROL OF CONCRETE MIXTURE"	2011
MASONRY	ACI 530/ASCE 5	2013
	ACI 530.1/ASCE 6	
	NCMA TEK 3-48 "BRACING CONCRETE MASONRY WALLS DURING CONSTRUCTION"	2005
BRCK	BA "TECHNICAL NOTES ON BRICK CONSTRUCTION"	
STEEL	ASCE "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS"	13TH EDITION
WELDING	AMERICAN WELDING SOCIETY AWS D1.1/D1.1M	2015
STEEL JOISTS	STEEL JOISTS INSTITUTE "STANDARD SPECIFICATION"	2015
METAL DECK	STEEL DECK INSTITUTE	1987
WOOD	"NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION"	2015
	ANSI/A&F&P&NDS	
SOILS REPORT	TO BE PROVIDED BY DEVELOPER	

REVISIONS


PROJECT: 2216
DATE: 10.30.22
DRAWN: WCH
CHECKED: WCH

KEYNOTES (X)

1. NEW 6" DIA STL POST DRIVEN BY BARGE PILE DRIVER.
2. NEW 1X6 TREX DECKING
3. NEW PT LVL
4. EXISTING WOOD PILES WITH NEW STEEL CAP
5. BF FISHING RAIL, 3/4" HIGH AND 32" WIDE MIN.
6. BF TURNING RADIUS

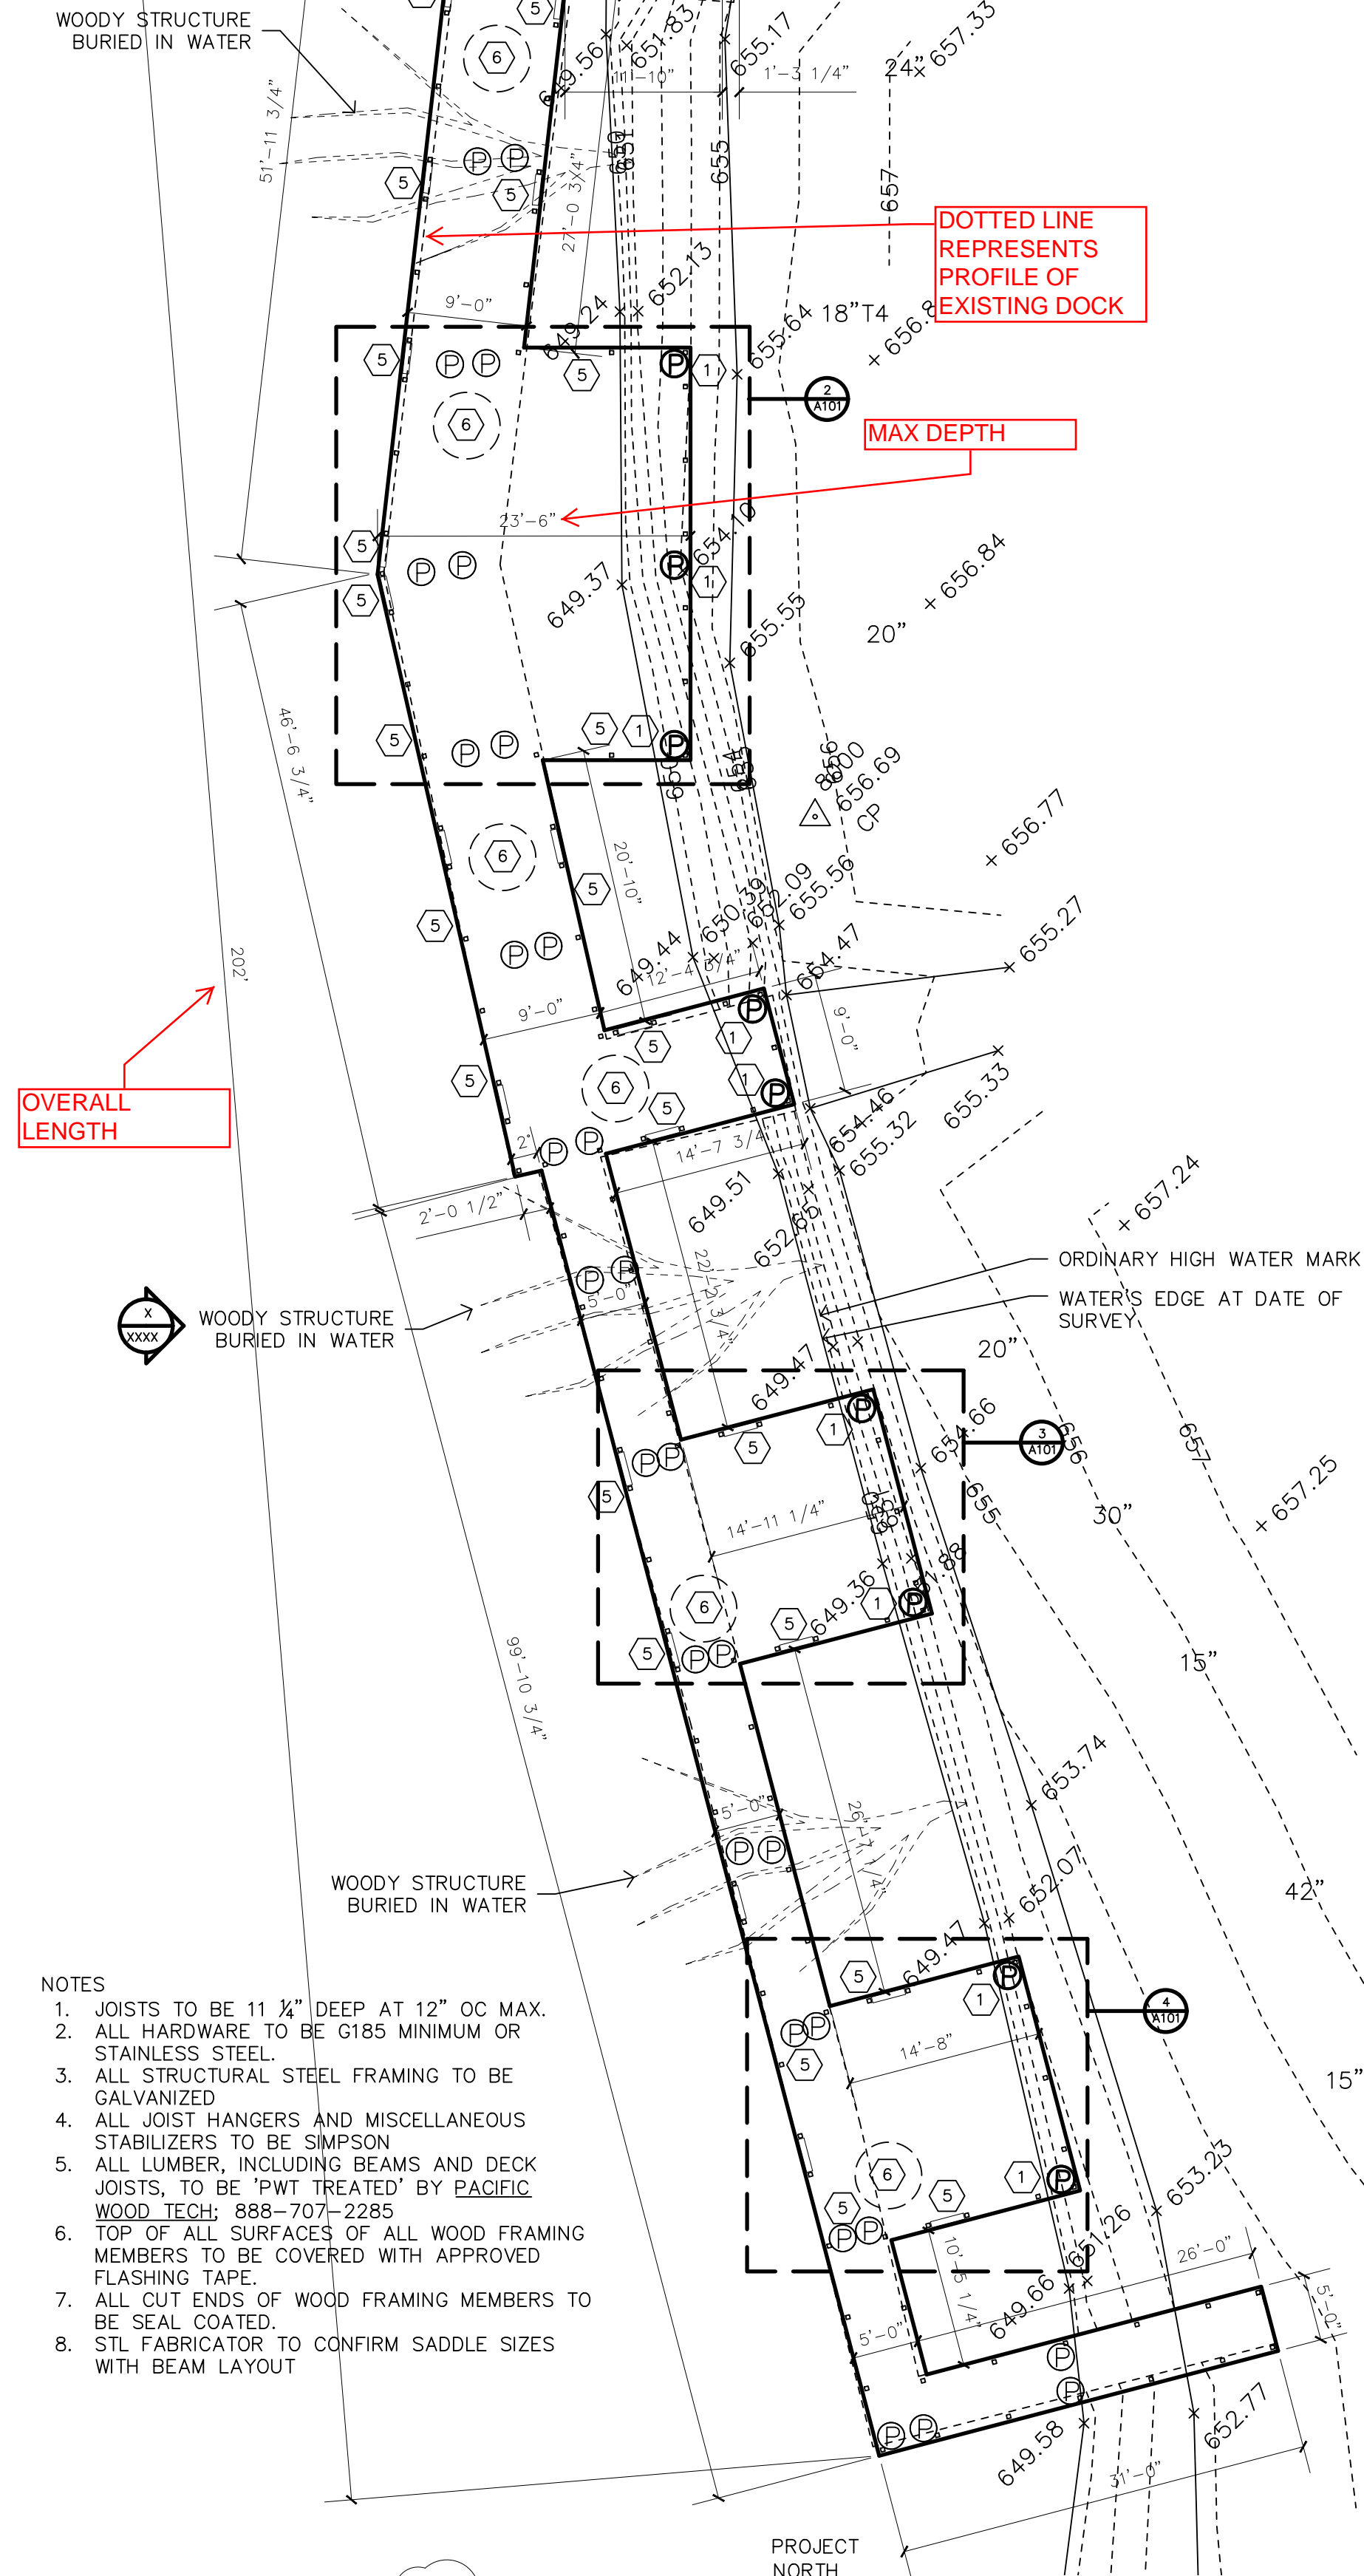

PRELIMINARY NOT TO BE USED FOR CONSTRUCTION
VERIFY ALL DIMENSIONS IN FIELD

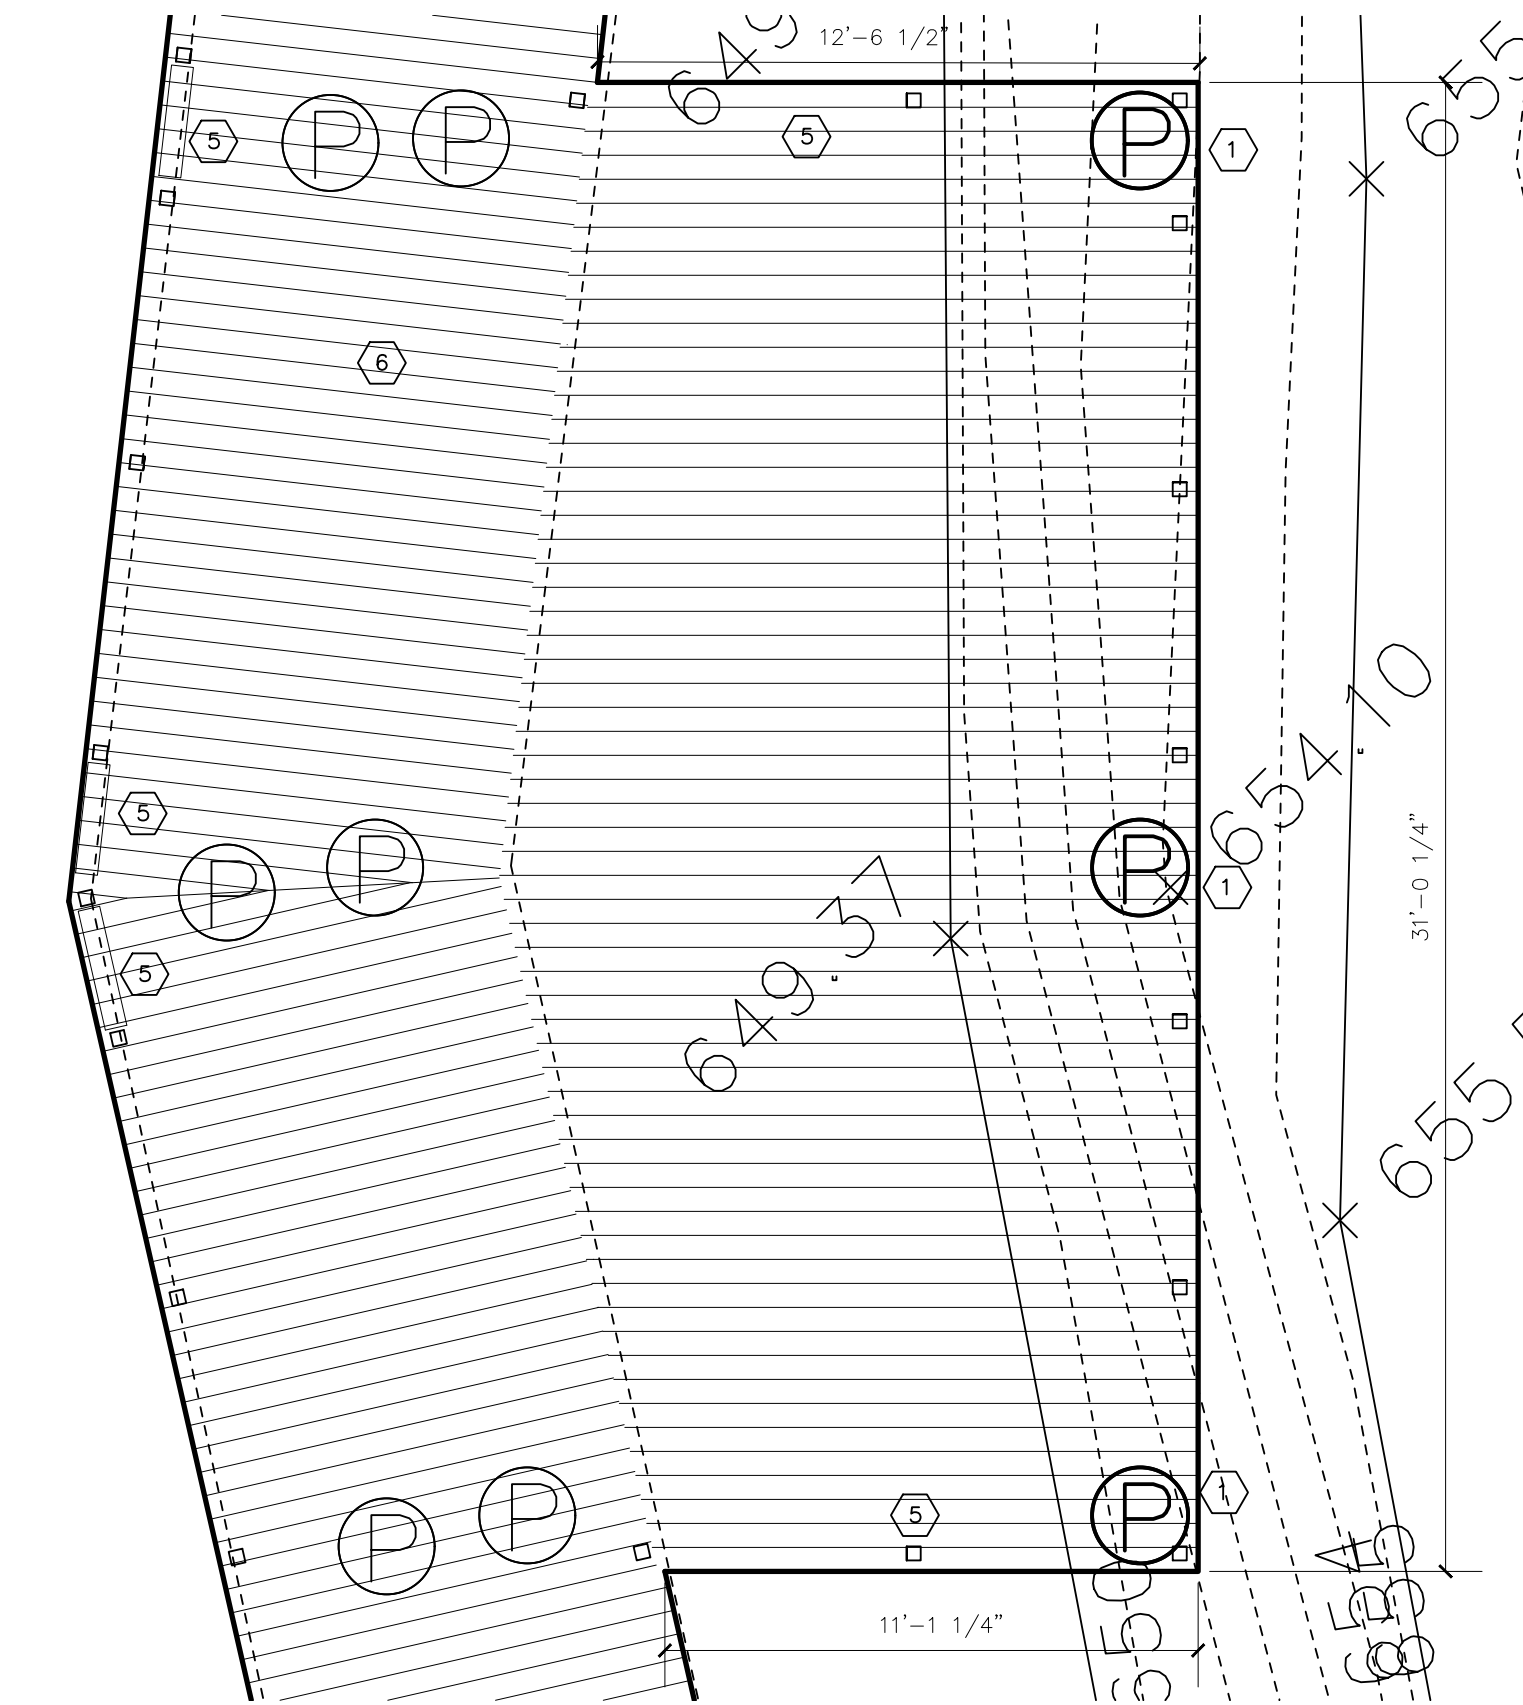

KEYNOTES

- 1. NEW 6 DIA STL POST DRIVEN BY BARGE PILE DRIVER.
- 2. NEW 1X6 TREX DECKING
- 3. NEW PT LVL

NOTES

- 1. JOISTS TO BE 11 1/4" DEEP AT 12" OC MAX.
- 2. ALL HARDWARE TO BE 6185 MINIMUM OR STAINLESS STEEL.
- 3. ALL STRUCTURAL STEEL FRAMING TO BE GALVANIZED
- 4. ALL JOIST HANGERS AND MISCELLANEOUS STABILIZERS TO BE SIMPSON
- 5. ALL LUMBER, INCLUDING BEAMS AND DECK JOISTS, TO BE 'PWT TREATED' BY PACIFIC WOOD TECH; 888-707-2285
- 6. TOP OF ALL SURFACES OF ALL WOOD FRAMING MEMBERS TO BE COVERED WITH APPROVED FLASHING TAPE.
- 7. ALL CUT ENDS OF WOOD FRAMING MEMBERS TO BE SEAL COATED.
- 8. STL FABRICATOR TO CONFIRM SADDLE SIZES WITH BEAM LAYOUT

1 FRAMING PLAN
SCALE: 3/32" = 1'-0"

2 DECKING PLAN
SCALE: 3/32" = 1'-0"

3 RAILING LOCATION PLAN
SCALE: 3/32" = 1'-0"

4 RAIL SECTION
SCALE: 1 1/2" = 1'-0"

5 RAIL ELEVATION
SCALE: 1 1/2" = 1'-0"

6 BF RAIL SECTION
SCALE: 1 1/2" = 1'-0"

9 RIM ATTACHMENT
SCALE: 1 1/2" = 1'-0"

9 PILE CONNECTION
SCALE: 1 1/2" = 1'-0"

PRELIMINARY NOT TO BE USED FOR CONSTRUCTION
VERIFY ALL DIMENSIONS IN FIELD

SITE PLANS

A102

HOPPE DESIGN, LLC
47032 MERIDIE, BELLEVILLE, MI 48111
734-218-2492

FRENCH LANDING
DOCK RENOVATION
12090 HAGGERTY RD., BELLEVILLE, MI 48111

PROJECT: 2216
DATE: 10.30.22
DRAWN: WCH
CHECKED: WCH

COPYRIGHT ALL RIGHTS RESERVED BY WAYDE C. HOPPE, ARCHITECT
NOT TO BE COPIED OR REPRODUCED WITHOUT WRITTEN PERMISSION

KEYNOTES

1. NEW 6 DIA STL POST DRIVEN BY BARGE PILE DRIVER.
2. NEW 1X6 TREX DECKING
3. NEW PT LVL

BEAM SCHEDULE


- A. SINGLE PLAY 1 3/4" X 11 7/8" LVL
- B. DOUBLE PLY 3 1/2" X 11 7/8" LVL
- C. TRIPLE PLY 5 1/2" X 11 7/8" LVL
- ALL BEAM BEARING TO BE A MIN OF 2.2" END BEARING AND 5.4" INTERMEDIATE BEARING

- NOTES
1. JOISTS TO BE 11 1/4" DEEP AT 12" OC MAX.
2. ALL HARDWARE TO BE G185 MINIMUM OR STAINLESS STEEL.
3. ALL STRUCTURAL STEEL FRAMING TO BE GALVANIZED
4. ALL JOIST HANGERS AND MISCELLANEOUS STABILIZERS TO BE SIMPSON
5. ALL LUMBER, INCLUDING BEAMS AND DECK JOISTS, TO BE 'PWT TREATED' BY PACIFIC WOOD TECH; 888-707-2285
6. TOP OF ALL SURFACES OF ALL WOOD FRAMING MEMBERS TO BE COVERED WITH APPROVED FLASHING TAPE.
7. ALL CUT ENDS OF WOOD FRAMING MEMBERS TO BE SEAL COATED.
8. STL FABRICATOR TO CONFIRM SADDLE SIZES WITH BEAM LAYOUT


1 BEAM LAYOUT
SCALE: 3/32" = 1'-0"



PRELIMINARY NOT TO BE USED FOR CONSTRUCTION
VERIFY ALL DIMENSIONS IN FIELD

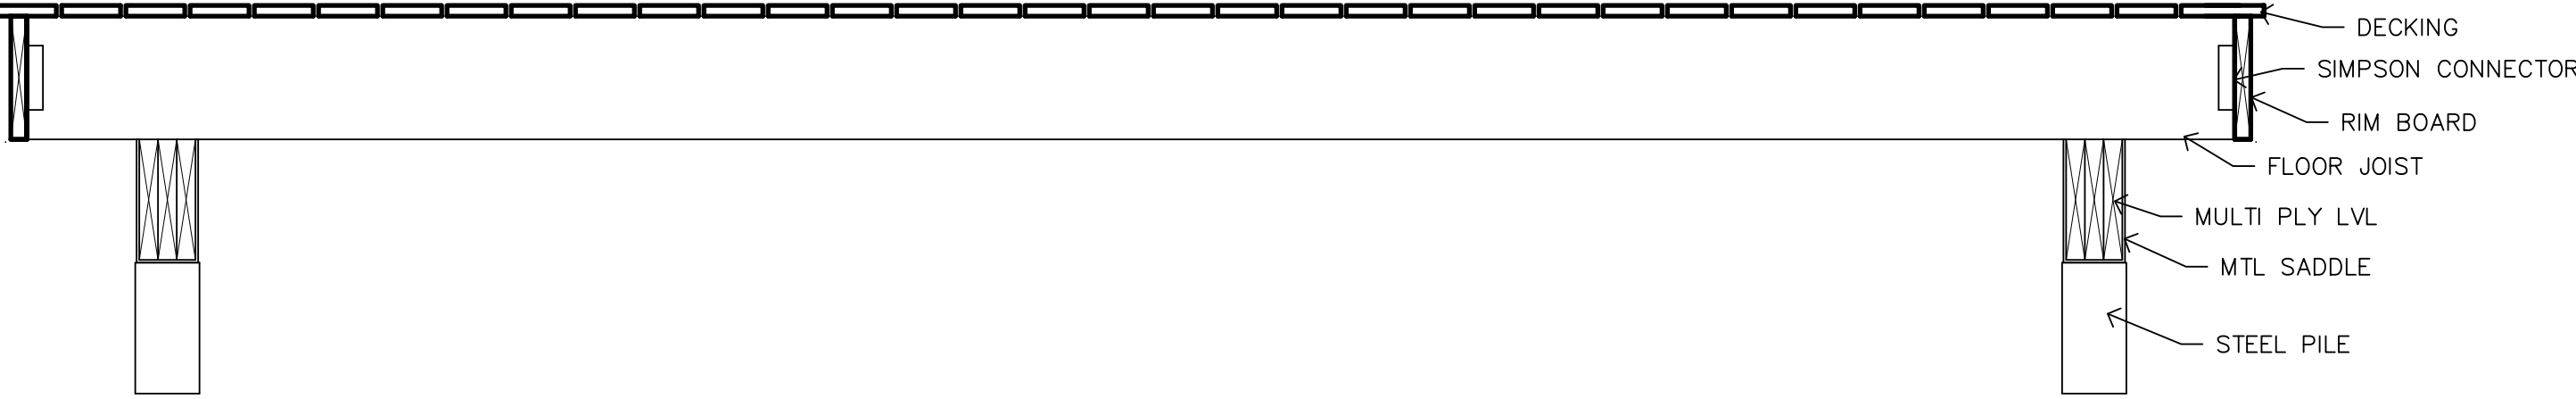


4 DECK SECTION
SCALE: 3/4" = 1'-0"

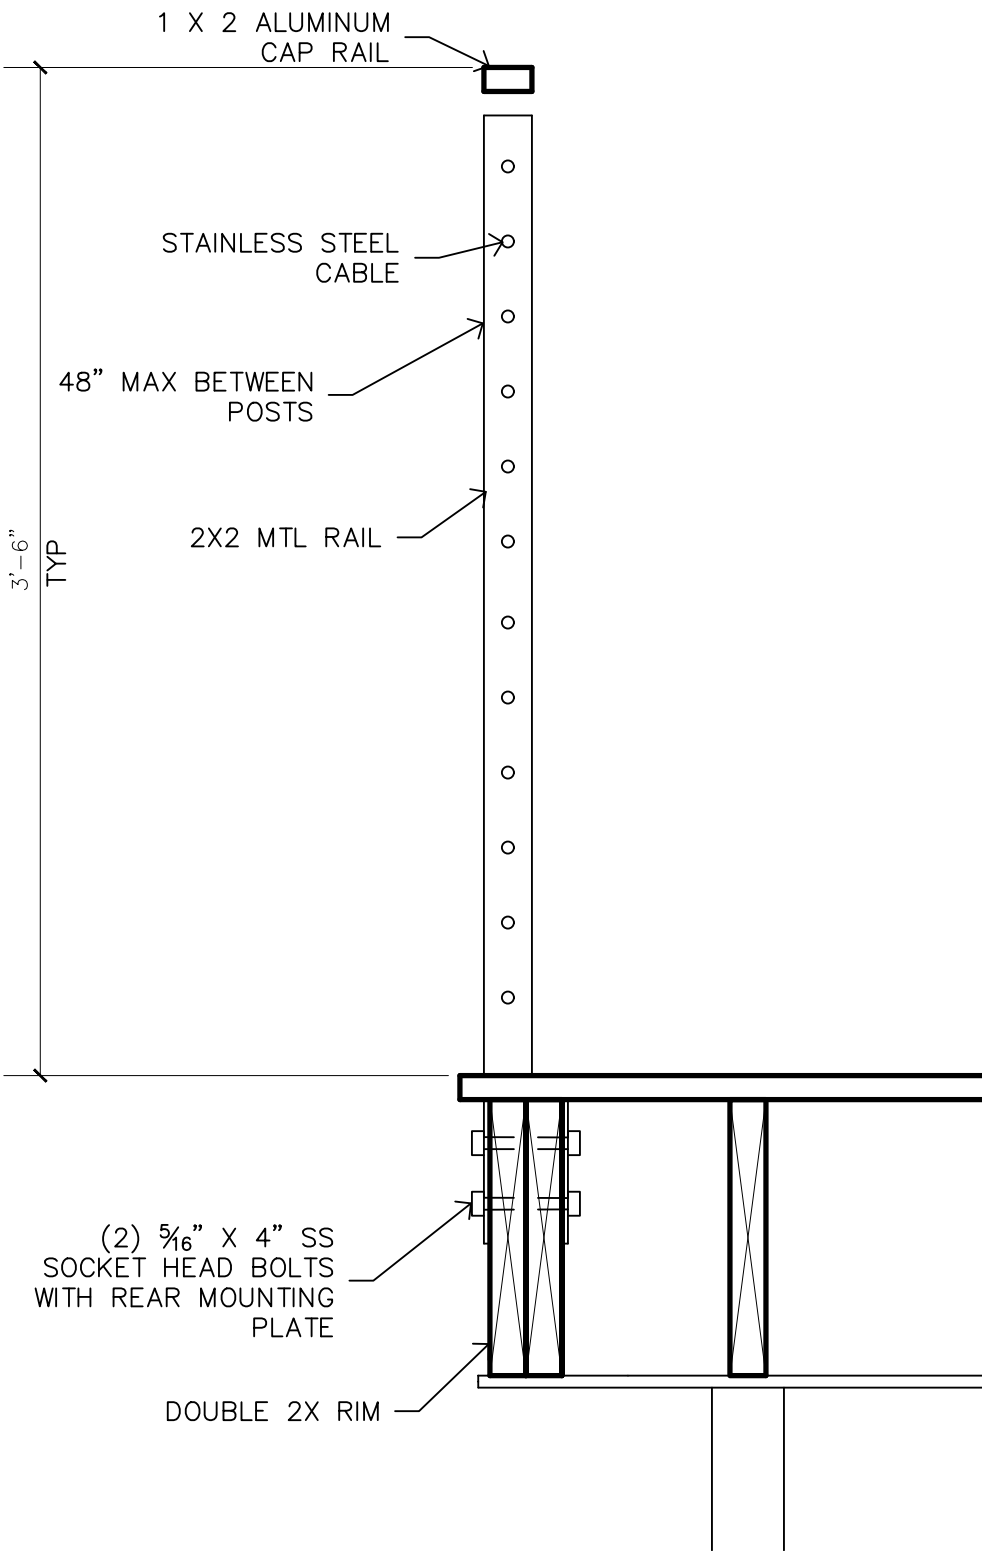


3 ALTERNATE RAILING
SCALE: 1 1/2" = 1'-0"

NOTE
RAIL SYSTEM TO BE MTL RAIL AND SS CABLES AS MANUFACTURED BY VIEWRAIL. SYSTEM TO BE RATED FOR COASTAL USE. PROVIDE ALL REQUIRED MATERIALS FOR A COMPLETE SYSTEM. SYSTEM TO RESIST LOADING AS REQUIRED BY CODE.

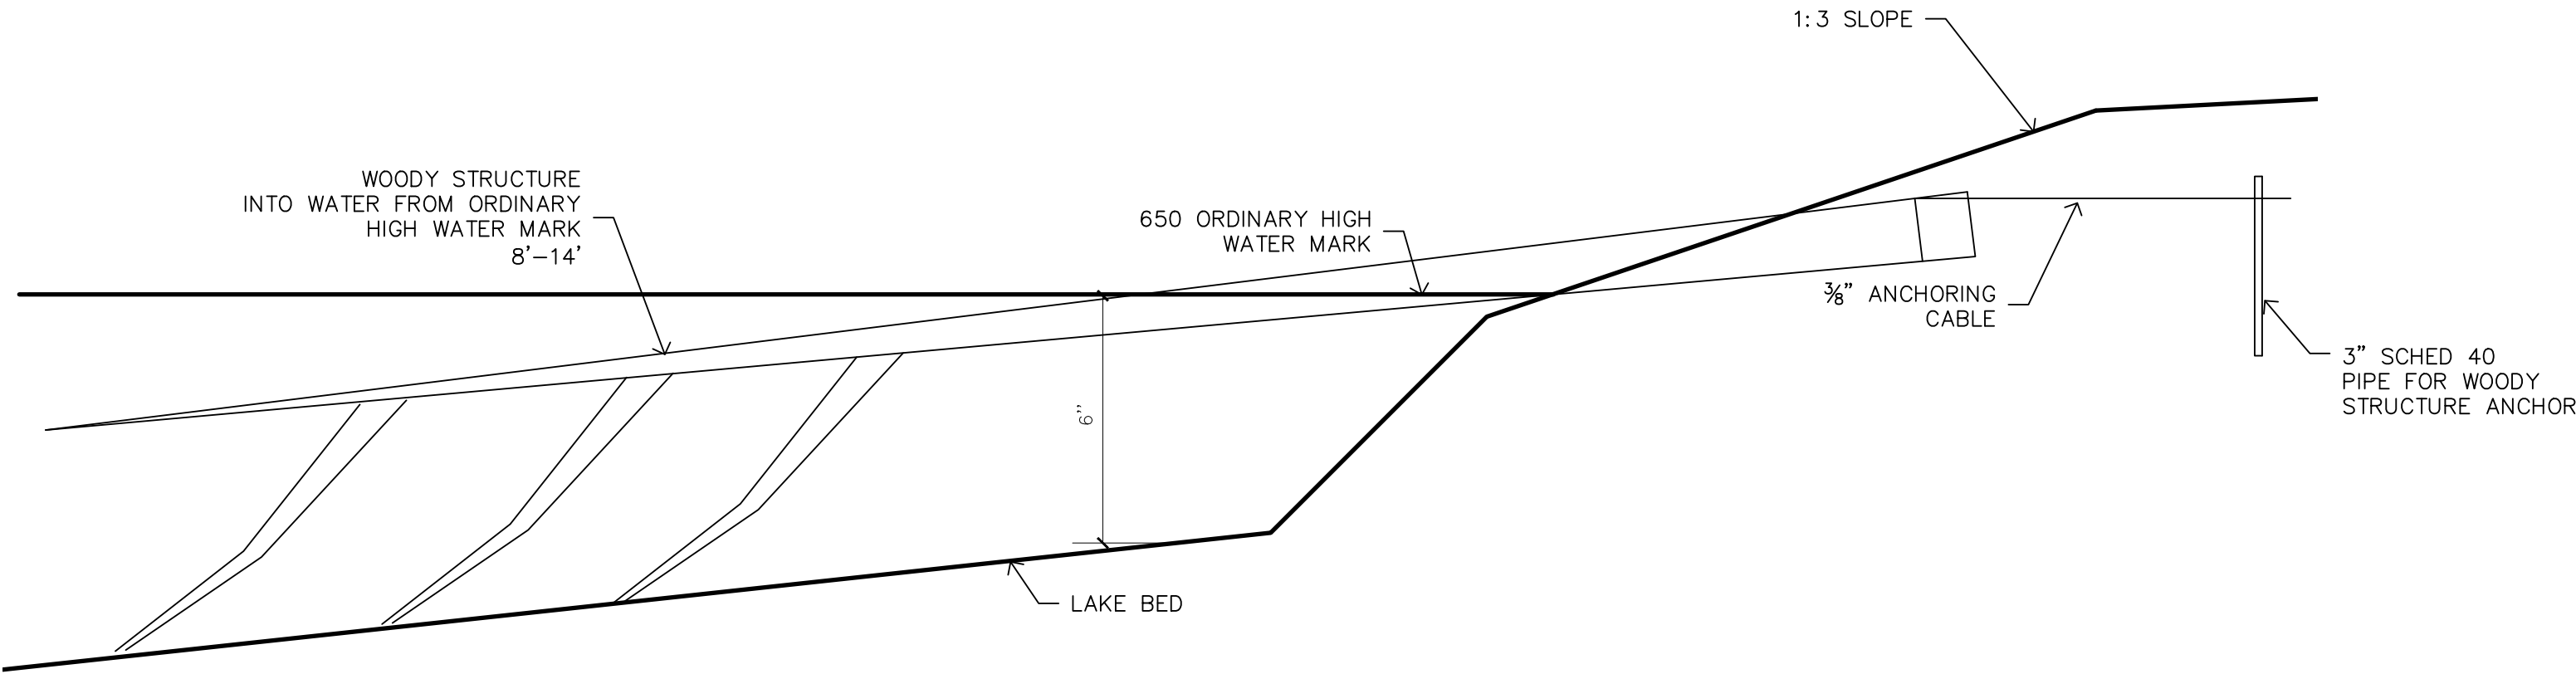

5 WOODY STRUCTURE AT WATERS EDGE
SCALE: 3/16" = 1'-0"

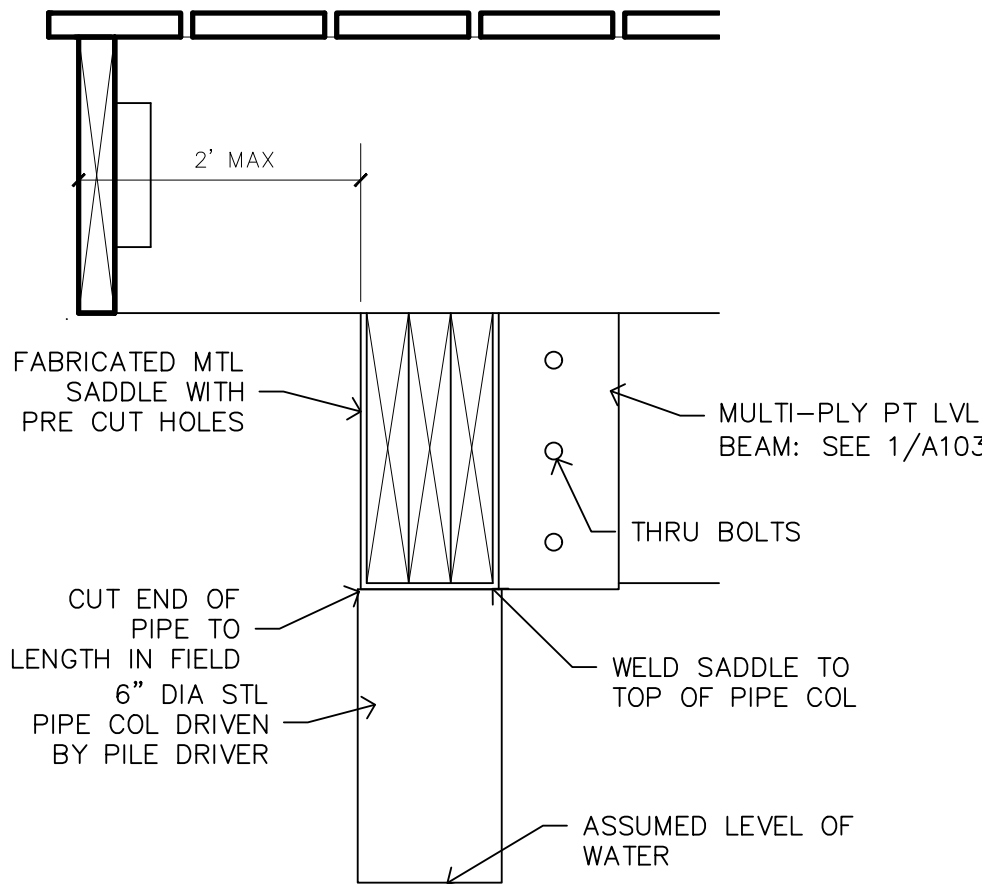

2 PILE CONNECTION
SCALE: 1 1/2" = 1'-0"

HOPPE DESIGN, LLC
47032 MERIDIE, BELLEVILLE, MI 48111
734-216-2492

REVISIONS	
ADD 1	2.23.23
ADD 2	3.29.23

PROJECT: 2216
DATE: 10.30.22
DRAWN: WCH
CHECKED: WCH

SITE PLAN AND DETAILS

COPYRIGHT ALL RIGHTS RESERVED BY WAYDE C. HOPPE, ARCHITECT
NOT TO BE COPIED OR REPRODUCED WITHOUT WRITTEN PERMISSION

A103

FRENCH LANDING
DOCK RENOVATION
12090 HAGGERTY RD., BELLEVILLE, MI 48111
































LIGHT FIXTURE SCHEDULE						
TYPE	MANUFACTURER	CATALOG NUMBER	LAMPS	NO-WATTS	MOUNTED	REMARKS
A	LAKE LITE	SOLAR DECK LIGHTS	LED	0.4	FLOOR	WHITE, 8 LUMENS

ELECTRICALⓧ

KEYNOTES


1. X

LEGEND

-  SWITCH ON RHEOSTAT
-  THREE WAY SWITCH
-  SWITCH WITH PILOT
-  SWITCH
-  SPECIAL OUTLET
-  DUPLEX OUTLET
-  QUAD OUTLET
-  WEATHERPROOF OUTLET
WP
-  GROUND FAULT
INTERUPTER
-  TELEPHONE/ COMPUTER
-  SMOKE DETECTOR
-  TELEVISION/ CABLE
-  CEILING MOUNTED
LIGHT FIXTURE
-  CEILING MOUNTED
LIGHT FIXTURE RECESSED
-  WALL MOUNTED
LIGHT FIXTURE
-  CEILING FAN/ LIGHT
-  SCONCE
-  MOTOR, ONE PHASE
-  GROUND MNTD
EXT. LIGHTING
-  2x4 LAY IN LIGHT
FIXTURE
-  1 X 4 LIGHT FIXTURE
-  PENDANT MOUNTED
OVERSIZED FIXTURE
-  EXIT SIGN
-  EXIT SIGN/
EMERGENCY LIGHT
-  FIRE ALARM
PULL STATION
-  HORN/ STROBE
-  COMPUTER JACK
-  RATE OF RISE
HEAT DETECTOR
-  DISCONNECT SWITCH
-  DISCONNECT SWITCH WITH
FUSE
-  AUDIO JUNCTION BOX—
PRE-WIRE PER DIRECTION
OF OWNER

ELECTRICAL NOTES

- ALL ELECTRICAL WORK SHALL COMPLY WITH THE N.E.C., COUNTY AND LOCAL CODES, ORDINANCES, AND REGULATIONS INCLUDING MIOSHA.
- COORDINATE ALL UNDERGROUND WORK WITH NEW AND EXISTING UNDERGROUND UTILITES BEFORE INSTALLATIONS.
- THE SECONDARY UNDERGROUND CONDUIT AND WIRE SHALL MEET THE REQUIREMENTS OF THE ELECTRIC UTILITY COMPANY.
- ALL EMPTY CONDUITS SHALL BE PROVIDED WITH A 1/4" DIA. POLYPROPYLENE FISH LINE.
- ALL UNDERGROUND CONDUITS SHALL BE INSTALLED 24" MINIMUM BELOW GRADE (UNLESS OTHERWISE SHOWN ON PLAN).
- ALL EXPOSED CONDUIT SHALL BE RIGID GALVANIZED STEEL, INSTALLED WITH WATERTIGHT CONDUIT FITTINGS. EXPANSION FITTINGS SHALL BE PROVIDED AT ALL TRANSITIONS FROM UNDERGROUND TO EXPOSED CONDUIT.
-
- ALL THREADED ELECTRICAL EQUIPMENT (CONDUIT, FITTINGS, BOLTS, SCREWS, ETC.) INSTALLED AT EXTERIOR SHALL BE COATED WITH ANTI-SEIZE COMPOUND PRIOR TO INSTALLATION.
- ALL WEATHERPROOF (W.P.) DUPLEX RECEPTACLES SHALL BE INSTALLED SUCH THAT COVER DOORS OPEN UPWARD.
- HAND DIG WHERE REQUIRED TO LOCATE EXISTING UTILITES PRIOR TO INSTALLATION OF NEW UNDERGROUND CONDUITS FOR POWER AND LIGHTING.
- PROVIDE A GREEN GROUND CONDUCTOR IN ALL SYSTEM CONDUITS, EXCEPT INSTRUMENT SIGNAL AND ALARM CONDUITS, INCLUDING BRANCH CIRCUIT CONDUITS FOR LIGHTING AND RECEPTACLES. GROUND CONDUCTOR SIZING SHALL BE PER N.E.C. TABLE 250.122 (MINIMUM) WHERE NOT SIZED ON THE DRAWINGS.
- WIRE SIZE SHALL BE #12 (MINIMUM) AND CONDUIT SIZE SHALL BE 3/4" (MINIMUM) FOR ALL POWER AND LIGHTING CIRCUITS WHERE NOT SIZED ON THE DRAWINGS.
- INSTALL SEPARATE GROUNDING CONDUCTOR TO ALL ISOLATED GROUND RECEPTACLES.
- LOCATE JUNCTION BOXES PER MANUFACTURER'S REQUIREMENTS.
- VERIFY LOCATION OF ALL POWER, PHONE, AND DATA JUNCTION BOXES WITH THE OWNER.
-
-
-
-
-
- ELECTRICAL CONTRACTOR TO COMPLY WITH NEC SECTION 110-C(A) AND (B) AND ALL TERMINATION CODE REQUIREMENTS.
- EC TO SIZE ALL WIRING, CIRCUITING, JB'S, BREAKERS, SUB PANELS, ETC., TO PROVIDE A COMPLETE SYSTEM.
- ELECTRICAL DRAWINGS ARE SCHEMATIC ONLY. EC IS RESPONSIBLE TO DETERMINE THE FINAL CONDUIT AND WIRING LAYOUT.

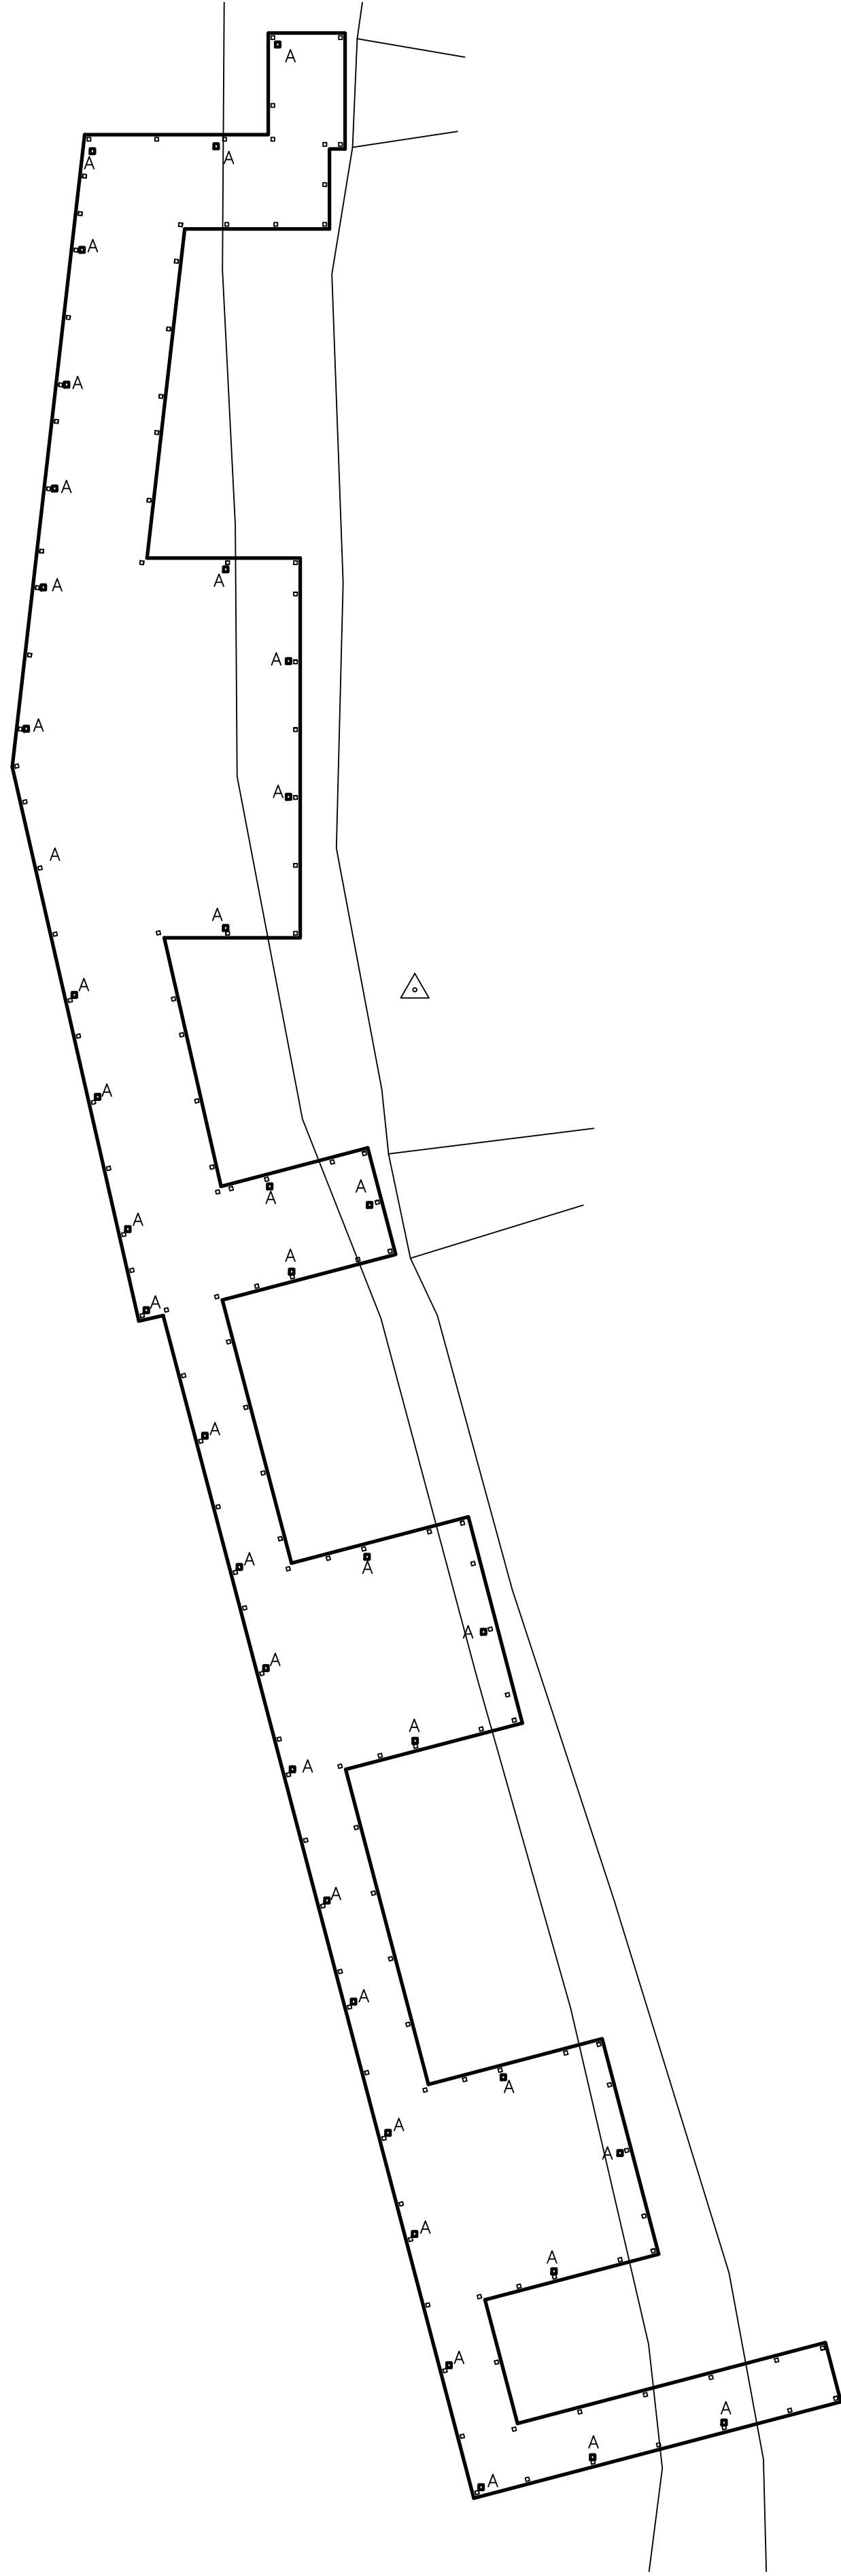

1
E101

LIGHTING PLAN

SCALE: 3/32" = 1'-0"



LIGHTING PLAN

COPYRIGHT ALL RIGHTS RESERVED BY WAYDE C. HOPPE, ARCHITECT
NOT TO BE COPIED OR REPRODUCED WITHOUT WRITTEN PERMISSION

FRENCH LANDING
DOCK RENOVATION
12090 HAGGERTY RD., BELLEVILLE, MI 48111

HOPPE DESIGN, LLC
47032 McBRIDE, BELLEVILLE, MI 48111
734-216-2492

REVISIONS

PROJECT: 2216
DATE: 10.30.22
DRAWN: WCH
CHECKED: WCH

PRELIMINARY NOT TO BE USED FOR CONSTRUCTION

E101