

ADDENDUM #1

Project: 5th & LIBERTY PARKING EXPANSION Belleville, Michigan HEI# 85320

Date: July 25, 2024

BIDDER QUESTIONS & RESPONSES

- The quantities on the bid form don't match the drawings. 19 new poles are shown and bid form only has 2.
 Response: There are only 2 proposed light poles in the project. The supplemental lighting drawings from the original project are for reference only. See attached plan.
- 2. I don't see a pay item for the new lighting control, foundation, panel, etc.


Response: The wiring conduit, panel work is incidental to the new light pole bid item.

3. Can we precast the lighting foundations? *Response: Yes.*

Please sign this addendum acknowledging that you have received this addendum and include it with the bid submittal.

By: _____ Company: _____



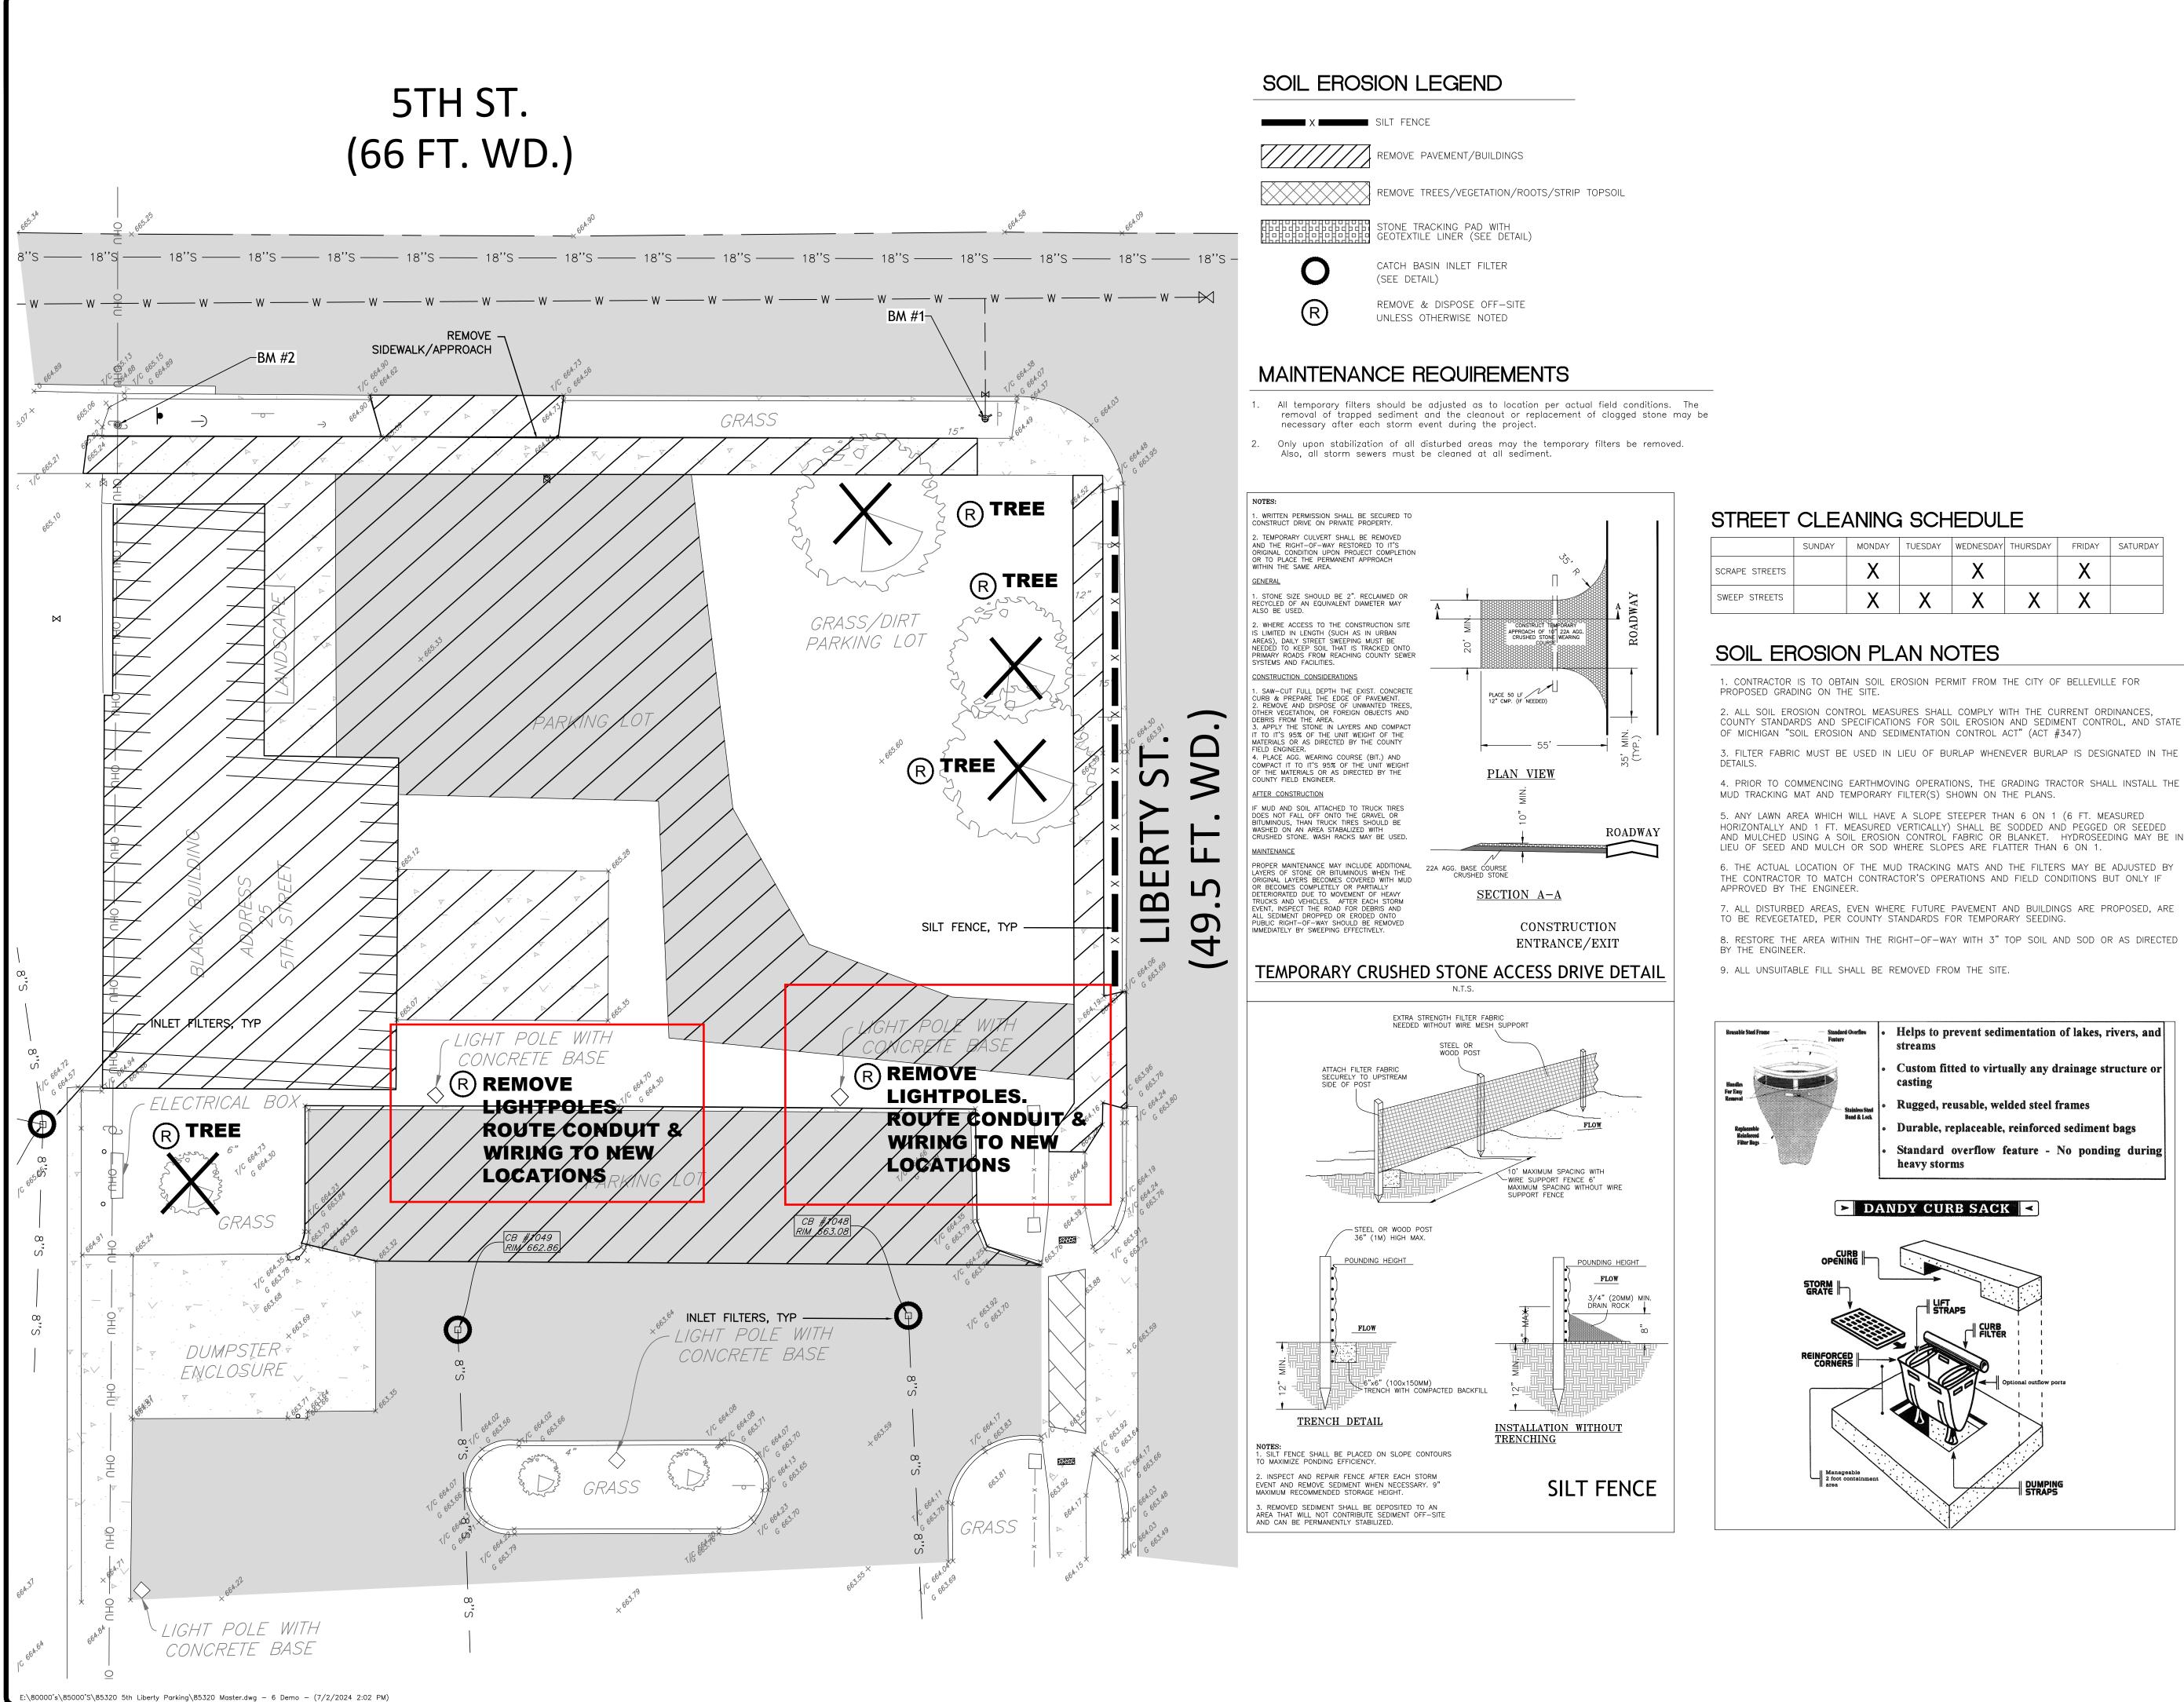

ANING SCHEDULE

MONDAY	TUESDAY	WEDNESDAY	THURSDAY	FRIDAY	SATURDAY
Х		Х		Х	
Х	Х	Х	Х	Х	

